

May 2026 Operations Department Report



**1-inch Service Line
Repair - Cedar Lane -
Ebbetts Pass**



**2-inch main - valve
replacement - Larkspur
Court - Forest Meadows**



**2-inch main - valve
replacement - Larkspur
Court - Forest Meadows**



**2-inch main - valve
replacement - Larkspur
Court - Forest Meadows**



**2-inch main - valve
replacement - Larkspur
Court - Forest Meadows**



**2-inch main - valve
replacement - Larkspur
Court - Forest Meadows**



**Autoflushers Deployed - Big
Trees Village - Ebbetts Pass**



**Yard and Field Maintenance -
Ebbett's Pass**



**Yard and Field Maintenance -
Ebbett's Pass**



**Yard and Field Maintenance -
Ebbett's Pass**



**HMGP Grant Funded Generators -
LS 17 - Copper Cove**



**HMGP Grant Funded Generators -
LS 19 - Copper Cove**



**HMGP Grant Funded Generators -
LS 7 - Poker Flat**




**8-inch, 6-inch valve replacement
and water line abandonment -
Hartvickson - Rancho Calaveras**



**8-inch, 6-inch valve replacement
and water line abandonment -
Hartvickson - Rancho Calaveras**




CWEA's Flush Fest - Lodi Lake

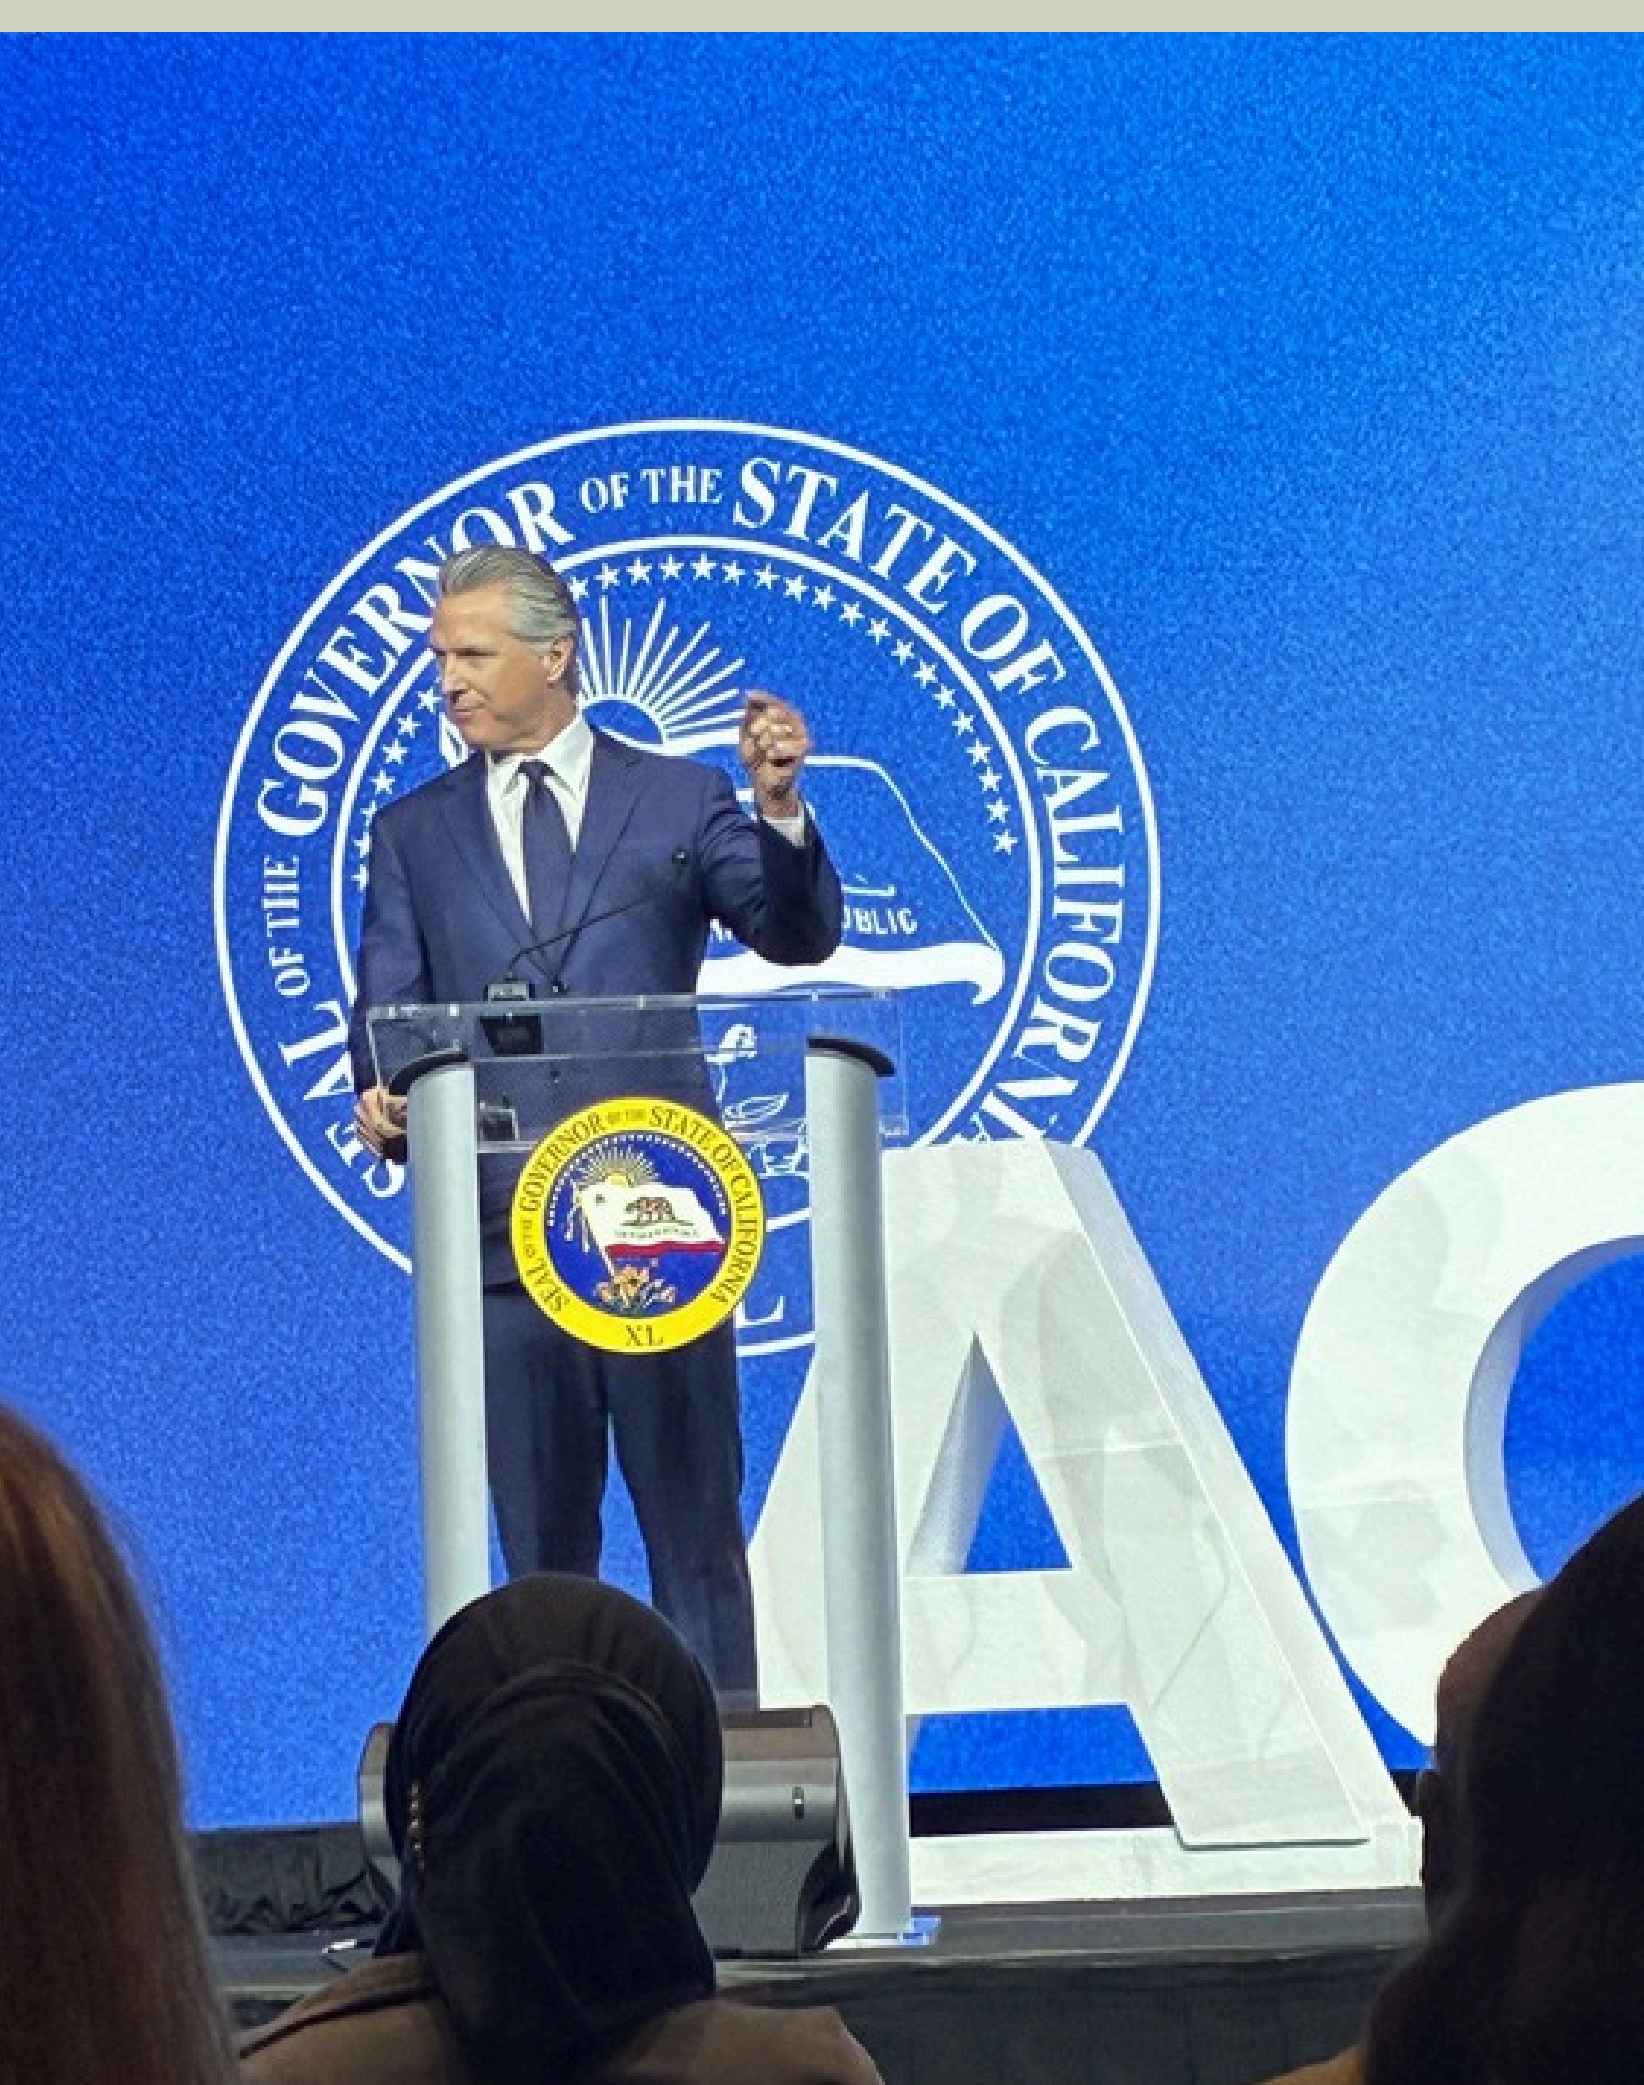


ACWA's Spring Conference - Sacramento



ACWA's Spring Conference - Sacramento

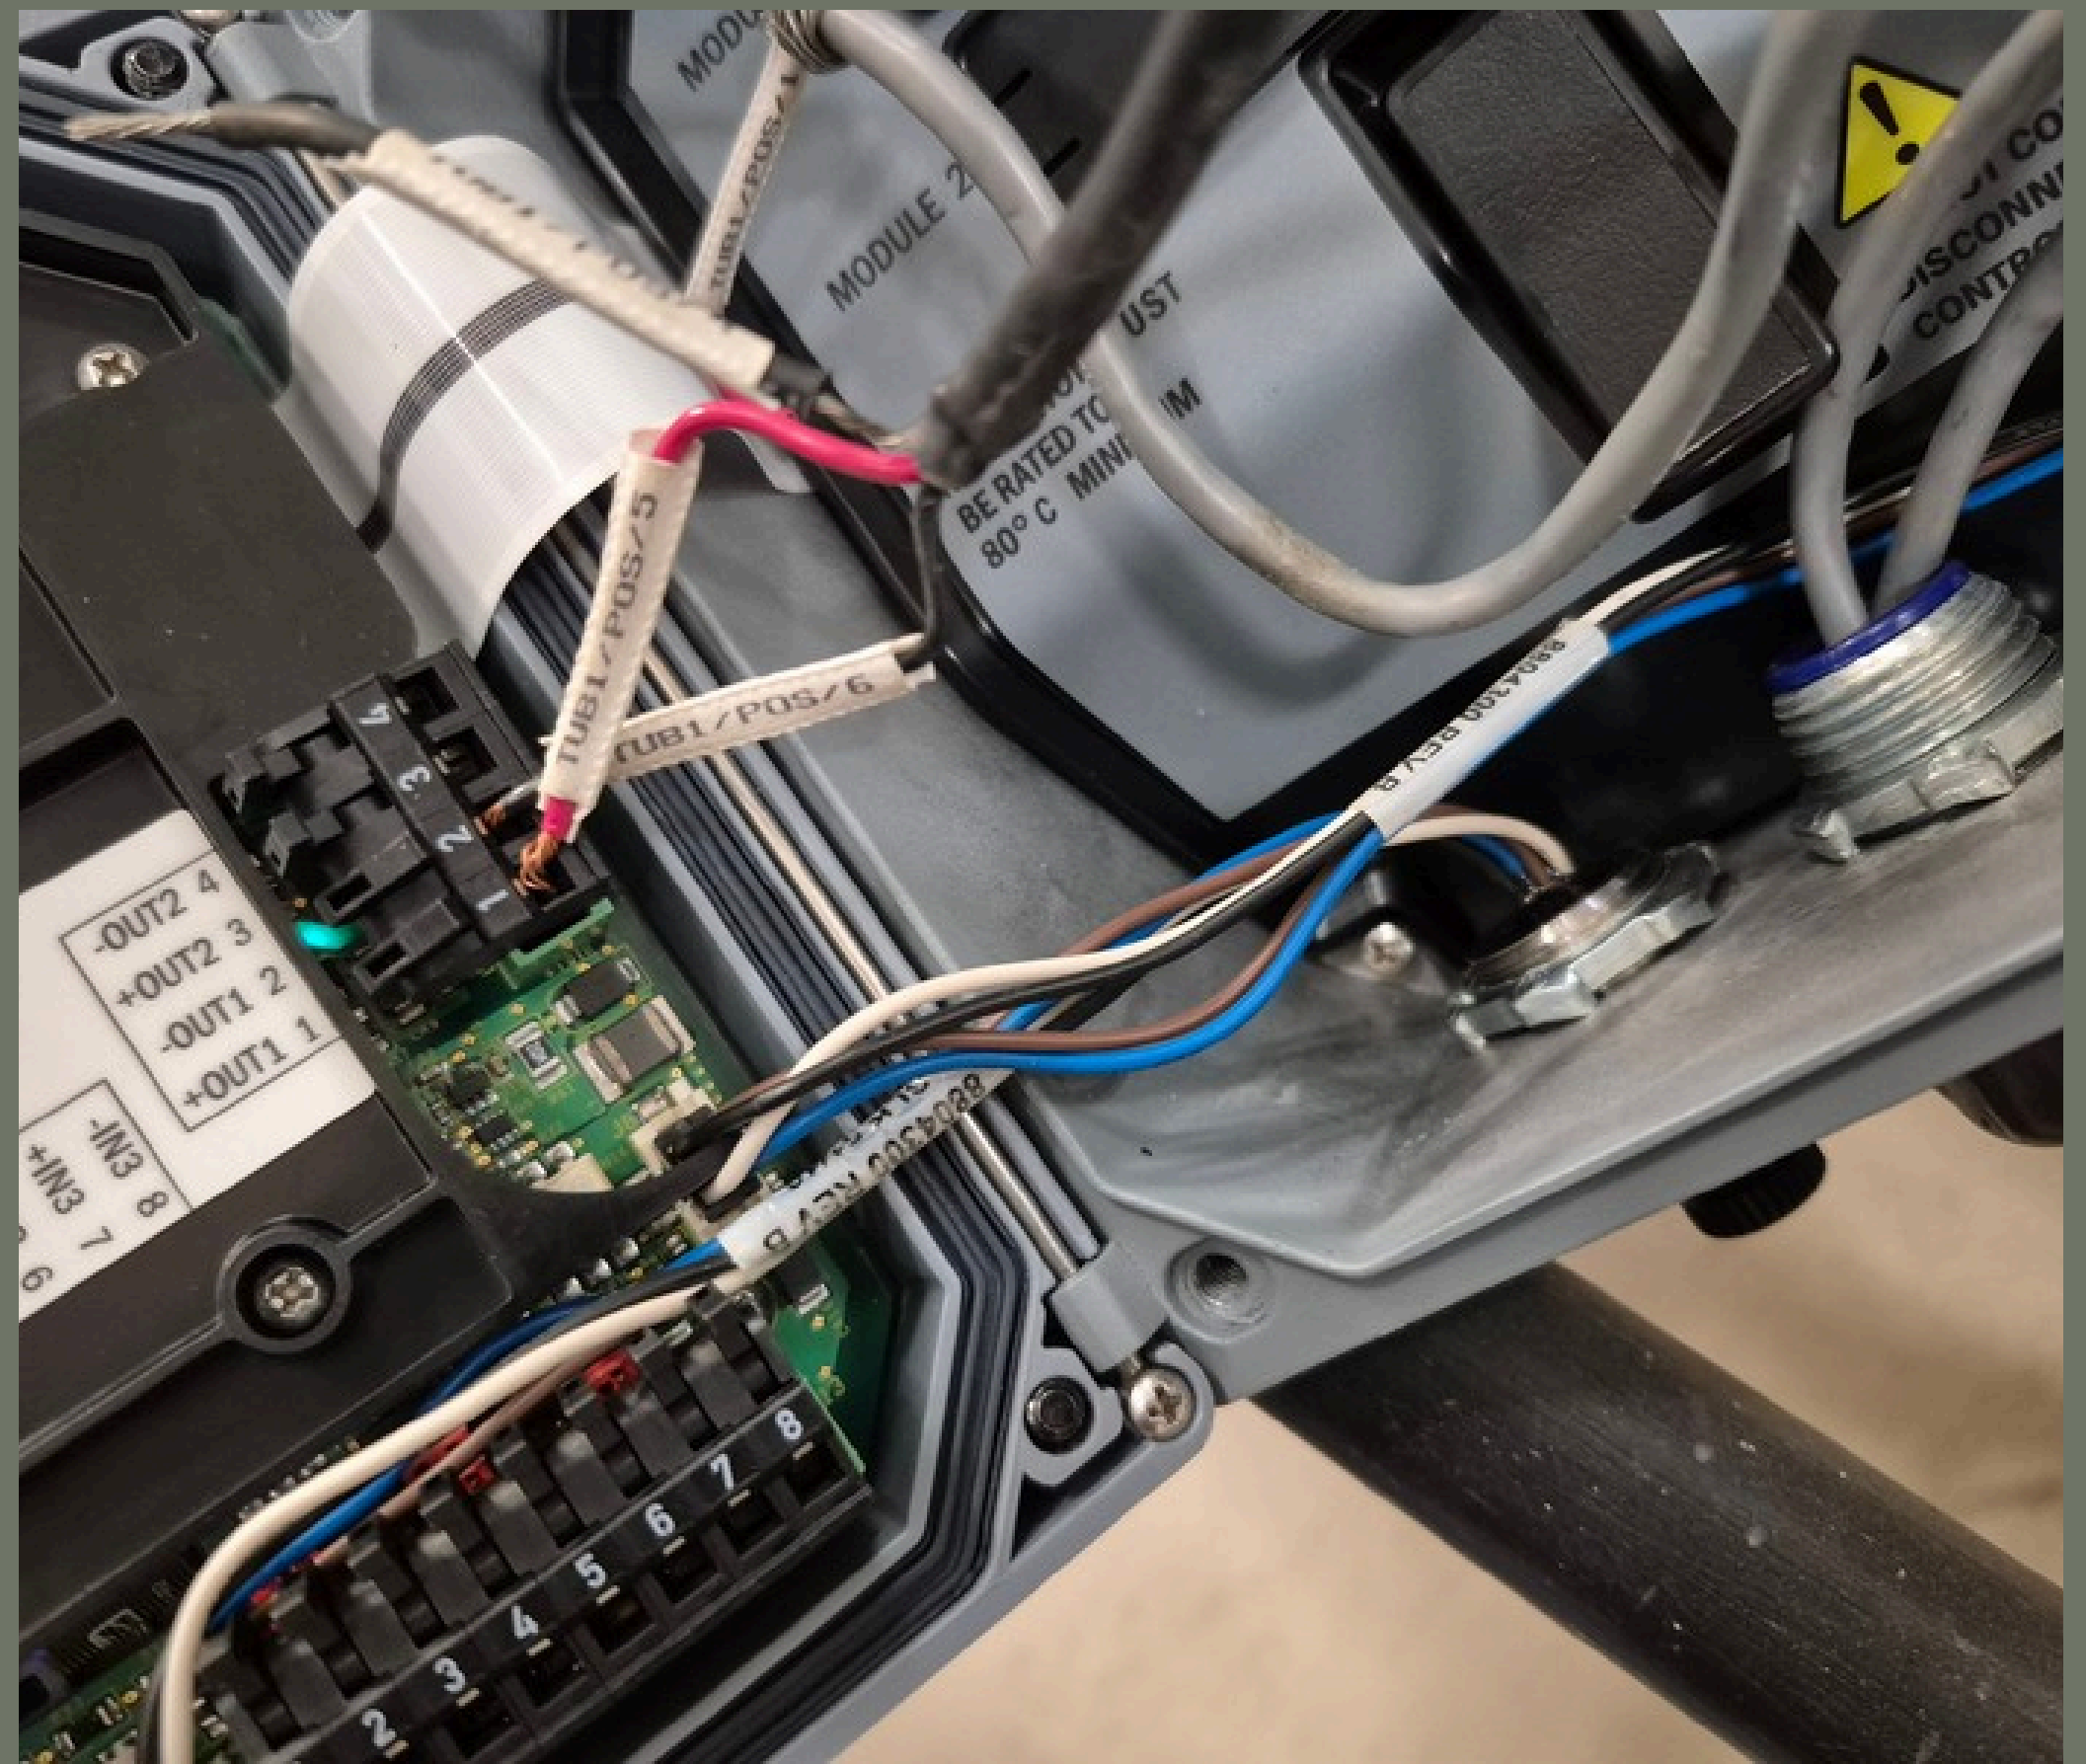

Electrical - Prepping Filter 1 For Rehab - Copper Cove

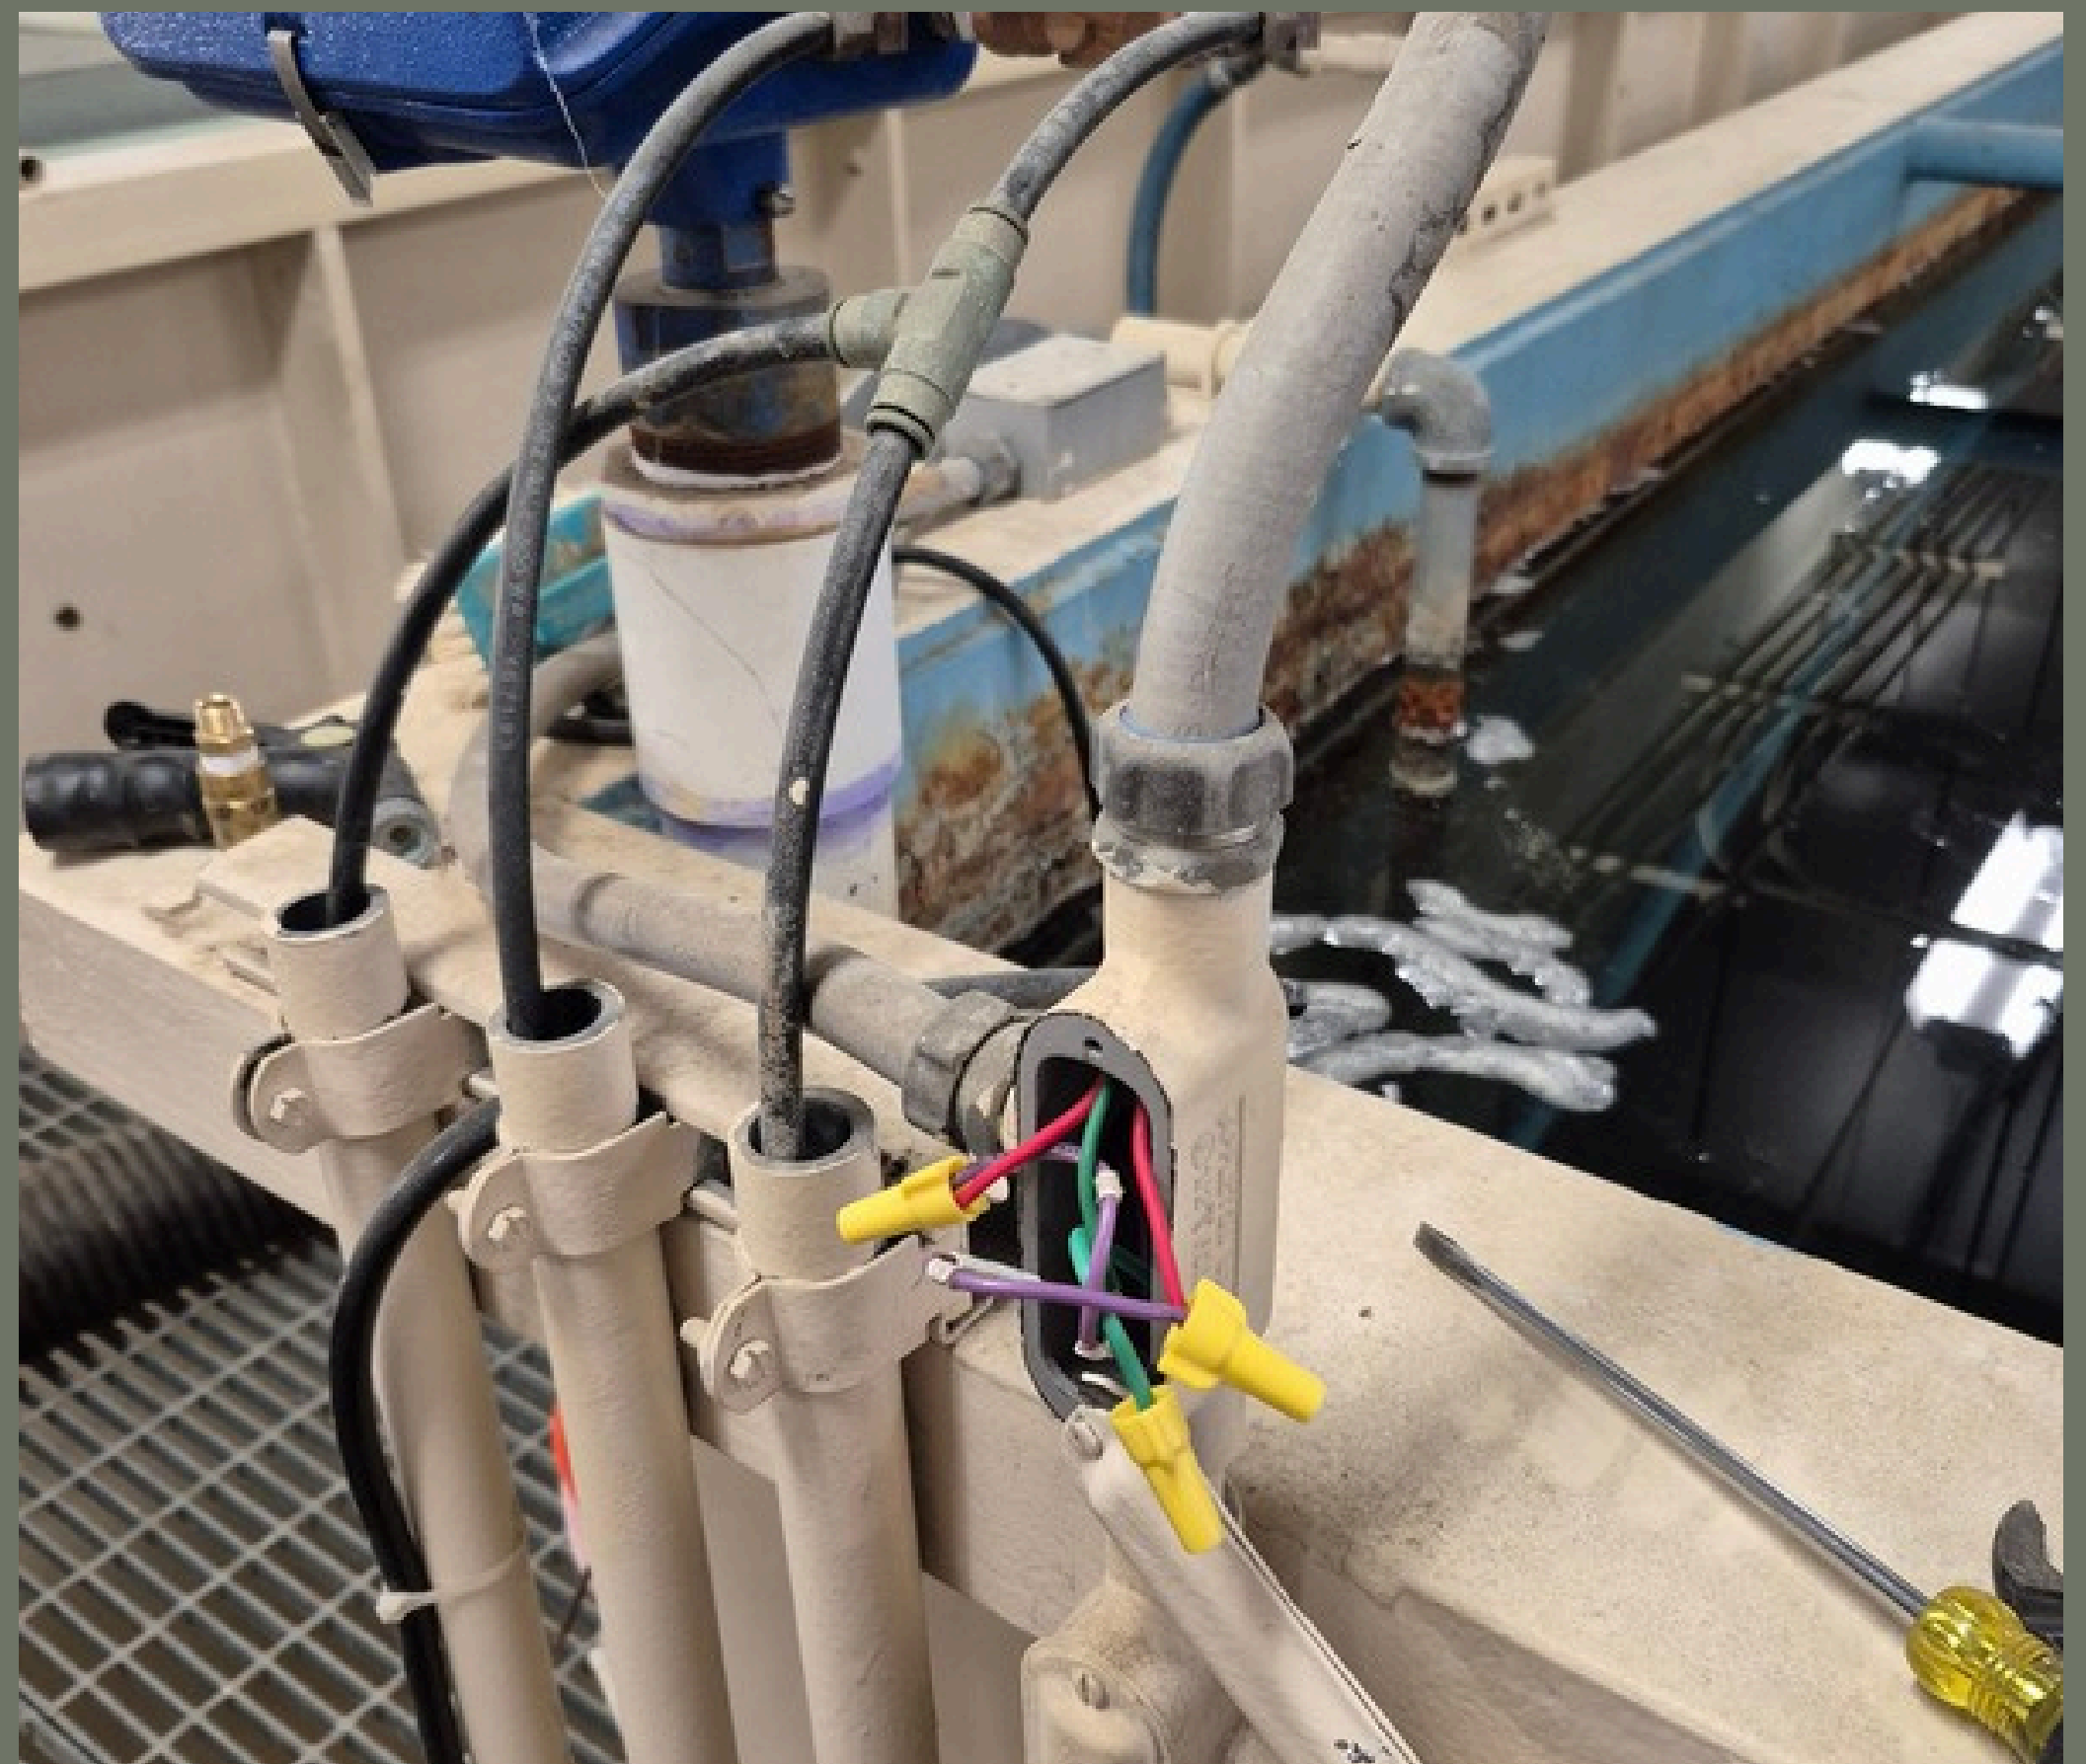

Electrical - Prepping Filter 1 For Rehab - Copper Cove



**Electrical - Prepping the C Tank
Hydro BLDG For Rehab - Copper**



**Electrical - Prepping the C Tank
Hydro BLDG For Rehab - Copper**



**Replaced failed AMI Repeater -
Friedman - Rancho Calaveras**



**Electrical + Mechanical -
Replacing Raw Pump 3 Motor -
Jenny Lind WTP**




**Electrical + Mechanical -
Replacing Raw Pump 3 Motor -
Jenny Lind WTP**



**Electrical + Mechanical -
Replacing Raw Pump 3 Motor -
Jenny Lind WTP**

Monday, May 18, 2026

Wastewater Trends

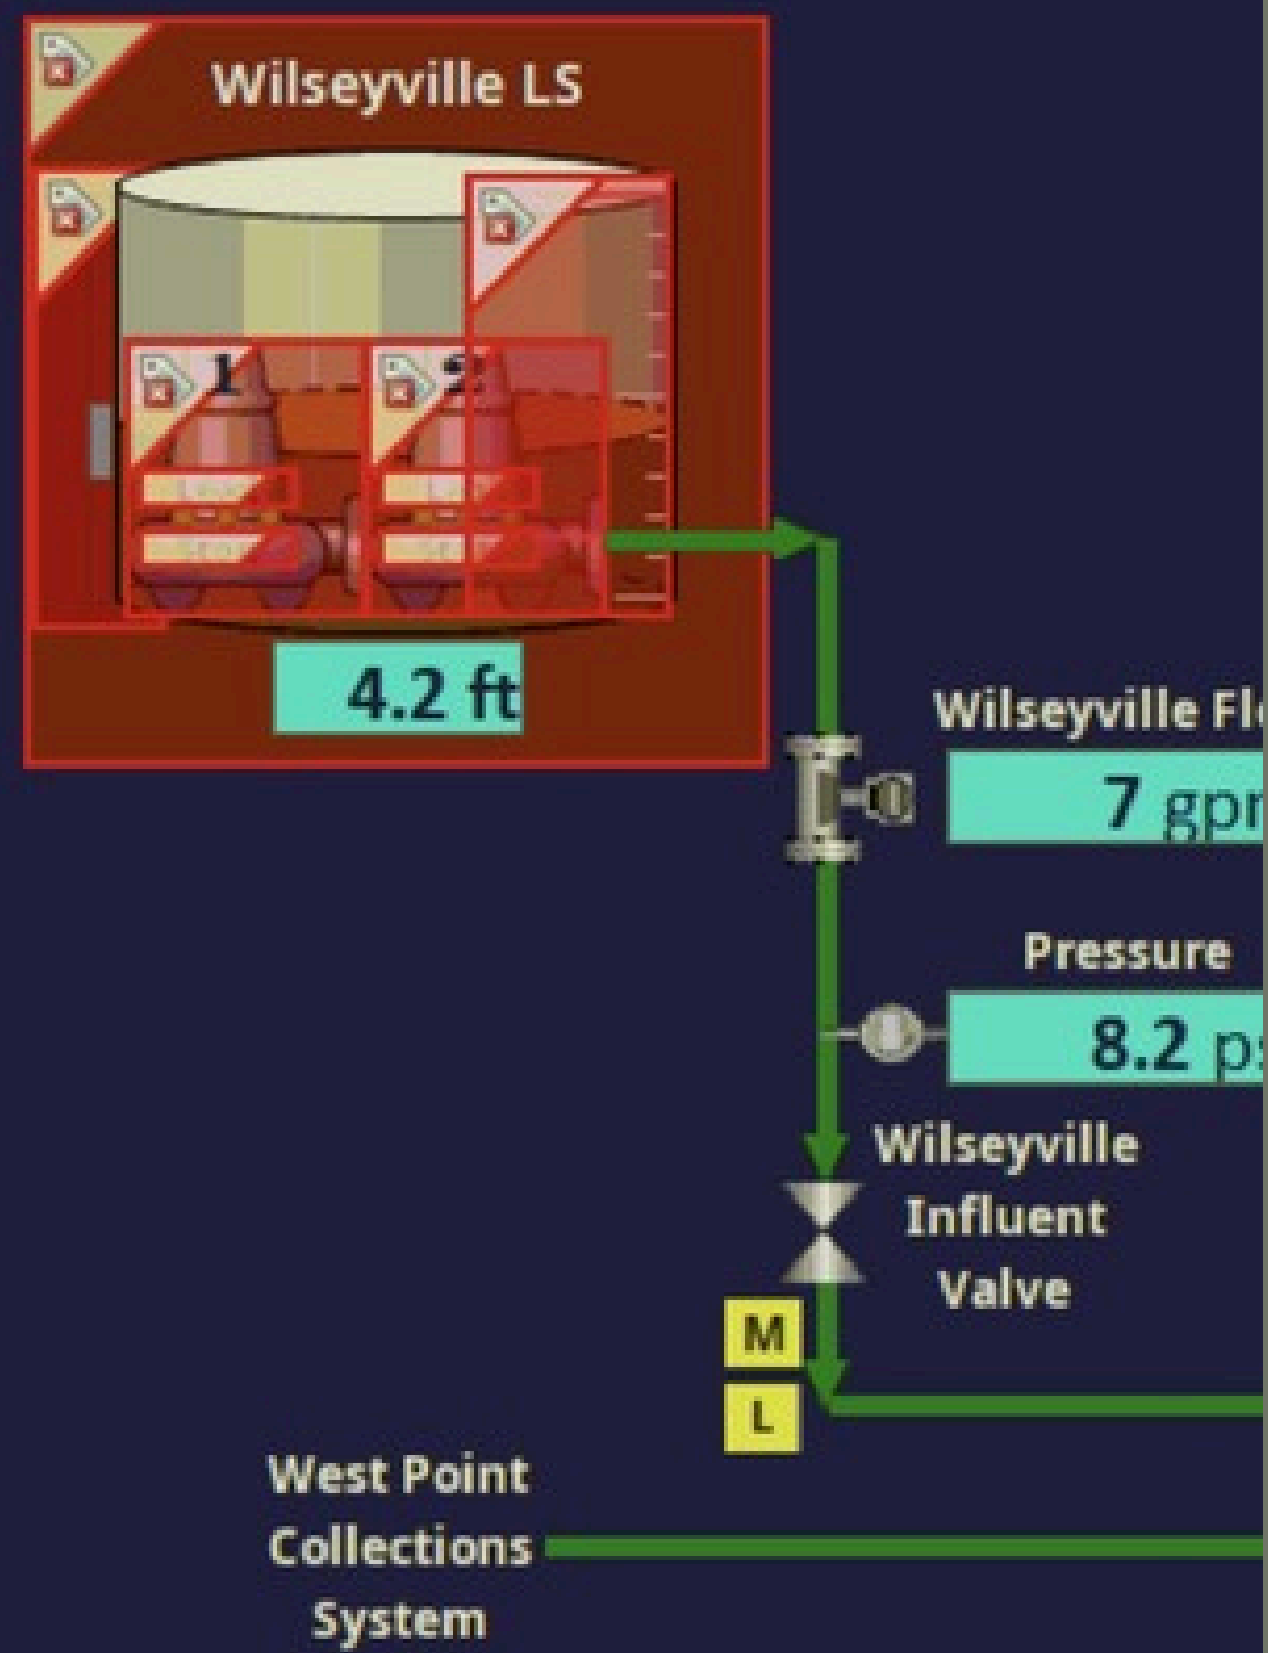

Electricians - Troubleshoot Comm Fail - Wilseyville Lift Station



Thank You